

SNYDER & ASSOCIATES

ENGINEERS & PLANNERS

ANKENY, IA
(515) 964-2020

ATLANTIC, IA
(712) 243-6505

CEDAR RAPIDS, IA
(319) 362-9394

MARYVILLE, MO
(660) 582-8888

ST. JOSEPH, MO
(816) 364-5222

November 16, 2006

Mr. Jay Incontro
President
Beaver Lake Association Board
Beaver Lake Water Treatment Facilities
2510 Oxford Court
Plattsmouth, Nebraska 68048

Re: Recommendation for Well Location

Dear Mr. Incontro

Snyder and Associates has been requested to provide additional information to support the recommendation made in Snyder's letter to the Board dated November 10, 2006. A graphic is attached which delineates the area of study for potential wells recommended by Layne-Western in their report date October 31, 2006. I apologize that the area has been hand drawn, but it is on a USGS map and is topographically accurate.

The cross-hatching inside the study area shows the land that is within 1,000 feet of existing wells and, therefore by regulation a well for a potable water system cannot be located there. The area where there is no cross-hatching indicates locations where wells could be located without being within the 1,000-foot restricted zone.

In the upper portion of the zone of study there is only a smaller triangular shaped area where it may be possible to drill a well outside of the 1,000-foot zone. However, there would be no opportunity for a redundant well for additional capacity due to the limited size of the area.


The southern most area between the bluffs and river has no restrictions with regard to other wells in the area. Again, this is the area where wells with the most capacity, best aquifer recharge rate, and is large enough for an additional well, if one should be required.

Snyder & Associates reaffirms that the best location for a well(s), and probably only location, is next to the Missouri River and in the area south of the stretch of creek (combination of Rock and Squaw Creeks) that enters the river. In this area there is an opportunity for multiple wells. If you have any questions, please call me at (712)243-6505.

Sincerely,

SNYDER AND ASSOCIATES, INC.

Richard A. Rohan
Principal/Branch Manager

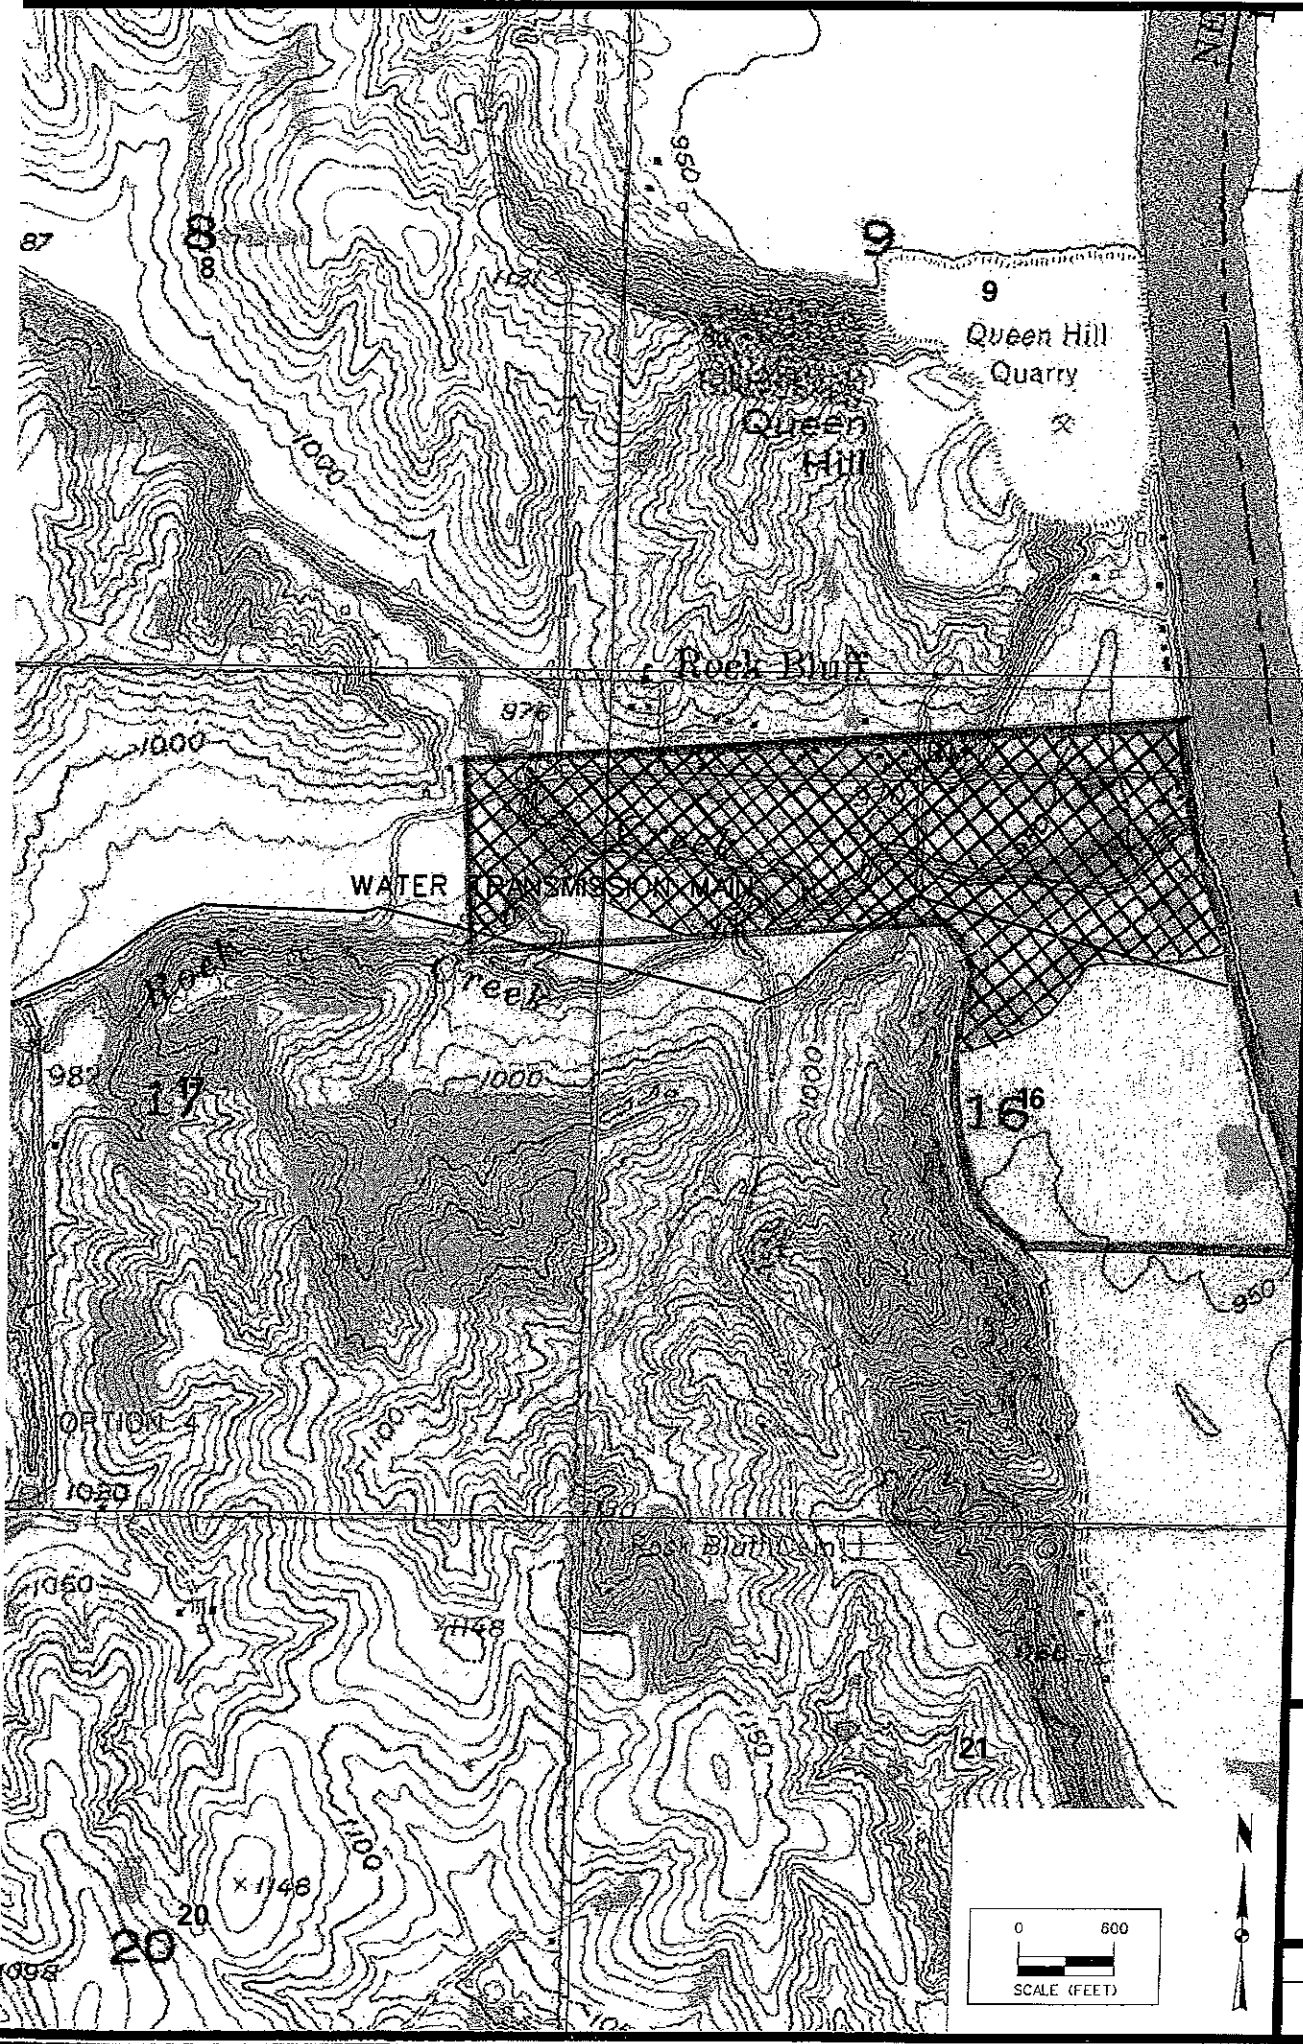

MARK	REVISION	DATE	BY
Engineer: RAR	Checked By: xx	Scale: 1"= 600'	
Technician: MJL	Date: 11/14/06	Field Bk: Pg:	
Project No: 1061117			
File No: D-			

PLATTSMOUTH, NEBRASKA


MARYVILLE, MO
660-692-8888
ST. JOSEPH, MO
816-864-5324

BEAVER LAKE ASSOCIATION

PROPOSED WATER TRANSMISSION MAIN ALTERNATIVE ROUTES

SNYDER & ASSOCIATES

ATLANTIC, IA
712-248-8805
COUNCIL BLUFFS, IOWA 51503
712-322-3202
916-864-5324



1061117 D-

